

4' Pendant Linear Direct/Indirect T8

White Channel and Perforated Basked With Inlay

Three 32W T8 Lamps (F32T8/835/R5)

TESTING CONDUCTED BY:
Building Acoustics and Lighting Laboratories, Inc.

DATE: 12/27/01

REPORT NUMBER: 11337.0

Zonal Cavity Coefficients of Utilization

Calling	.80		.70		.50		.30		.10		.0							
Wall	.70	.50	.30	.10	.70	.50	.30	.10	.50	.30	.10	.50	.30	.10	.00			
0	.77	.77	.77	.77	.69	.69	.69	.69	.54	.54	.54	.40	.40	.40	.28	.28	.28	.22
1	.70	.67	.64	.62	.63	.60	.58	.56	.47	.46	.44	.35	.34	.33	.24	.24	.23	.18
2	.64	.59	.54	.50	.57	.53	.49	.46	.41	.39	.37	.31	.29	.28	.21	.20	.20	.15
3	.58	.52	.46	.42	.52	.46	.42	.38	.37	.33	.31	.28	.25	.24	.19	.18	.17	.13
4	.54	.46	.40	.35	.48	.41	.36	.32	.33	.29	.26	.25	.22	.20	.17	.16	.15	.11
5	.49	.41	.35	.30	.44	.37	.31	.28	.29	.25	.22	.22	.19	.17	.15	.14	.13	.10
6	.45	.36	.30	.25	.40	.33	.28	.24	.26	.22	.20	.20	.17	.15	.14	.12	.11	.08
7	.42	.33	.27	.23	.37	.30	.24	.21	.23	.20	.17	.18	.15	.13	.12	.11	.10	.07
8	.39	.30	.24	.20	.34	.27	.22	.18	.21	.18	.15	.16	.14	.12	.11	.10	.08	.05
9	.36	.27	.21	.18	.32	.24	.19	.16	.19	.16	.13	.15	.12	.10	.10	.09	.07	.05
10	.33	.24	.19	.16	.30	.22	.18	.14	.18	.14	.12	.13	.11	.09	.09	.08	.07	.05

RCR


Lumen Summary

Zone	Lumens	% Lamp	% Ftst
0-30	542	6.1	8.1
0-40	873	9.9	13.0
0-60	1485	16.8	22.2
0-90	1911	21.6	28.5
90-120	1073	12.1	16.0
90-130	1847	20.9	27.6
90-150	3531	39.9	52.7
90-180	4794	54.2	71.5
0-180	6704	75.8	100.0

IES Spacing Criteria

End = 1.2 Diagonal = 1.2 Cross = 1.3

Zonal Lumens

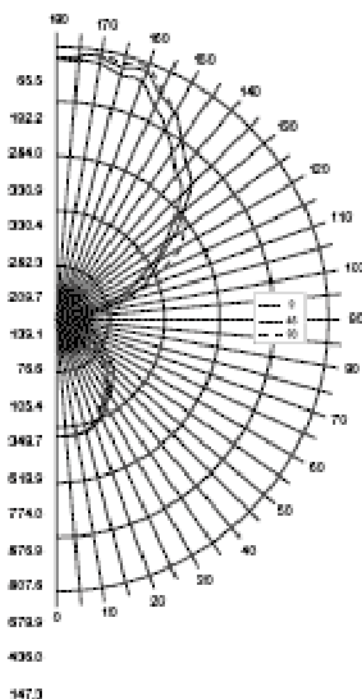

End view showing placement of three T8 lamps.

Ordering Information:

SD FORM 0088

SERIES	PROFILE	LENGTH	LAMPS	BALLAST	OPTIONS
STD	PL				