

### STL22B2U

2x2 Recessed Parabolic  
White Steel Luminaire  
Housing

2/32" W T8 6" U-Lamps

(FB32WT8/835/RS)

3" Deep 9-cell

Semi-specular

Silver Aluminum

Parabolic Louver

Celling	.80				.70				.50			.30			.10			.0
Wall	.70	.50	.30	.10	.70	.50	.30	.10	.50	.30	.10	.50	.30	.10	.50	.30	.10	.00
0	.62	.62	.62	.62	.61	.61	.61	.61	.58	.58	.58	.55	.55	.55	.53	.53	.53	.52
1	.58	.56	.55	.53	.57	.55	.54	.52	.53	.52	.51	.51	.50	.49	.49	.48	.48	.47
2	.54	.51	.48	.46	.53	.50	.48	.45	.48	.46	.44	.47	.45	.43	.45	.44	.42	.42
3	.50	.46	.43	.40	.49	.45	.42	.40	.44	.41	.39	.43	.40	.38	.41	.39	.38	.37
4	.47	.42	.38	.35	.46	.41	.37	.35	.40	.37	.34	.39	.36	.34	.38	.35	.33	.32
5	.43	.37	.33	.30	.42	.37	.33	.30	.36	.33	.30	.35	.32	.30	.34	.31	.29	.28
6	.40	.34	.30	.27	.39	.33	.30	.27	.33	.29	.27	.32	.29	.26	.31	.28	.26	.25
7	.37	.31	.27	.24	.36	.30	.26	.24	.29	.26	.23	.29	.26	.23	.28	.25	.23	.22
8	.34	.28	.24	.21	.33	.27	.23	.21	.27	.23	.21	.26	.23	.20	.25	.22	.20	.19
9	.31	.25	.21	.18	.31	.25	.21	.18	.24	.20	.18	.23	.20	.18	.23	.20	.18	.17
10	.29	.23	.19	.16	.29	.22	.19	.16	.22	.18	.16	.21	.18	.16	.21	.18	.16	.15

A.L.P.-LAPLDA2209STS

TESTING CONDUCTED BY:

Building Acoustics and  
Lighting Laboratories, Inc.

DATE: 3/30/98


REPORT NUMBER: 9803.0

20

Lumen Summary

Zone	Lumens	% Lamp	% Ft.²
0-30	1066	19.0	36.5
0-40	1670	29.8	57.2
0-60	2703	48.3	92.6
0-90	2920	52.1	100.0
90-120	0	0.0	0.0
90-130	0	0.0	0.0
90-150	0	0.0	0.0
90-180	0	0.0	0.0
0-180	2920	52.1	100.0

Zonal Lumen Summary

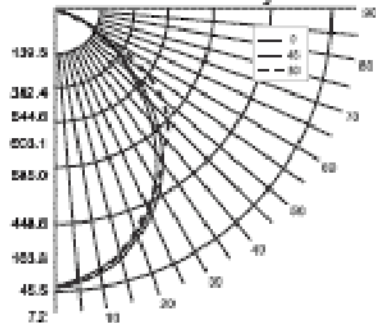

IES Spacing Criteria

End = 1.1	Diagonal = 1.1	Cross = 1.1
-----------	----------------	-------------

### STL22B2U

2x2 Recessed Parabolic  
White Steel Luminaire  
Housing

2/32" W T8 6" U-Lamps

(FB32WT8/835/RS)

3" Deep 9-cell

Semi-specular Silver

Anodized Aluminum

Parabolic Louver

Celling	.80				.70				.50			.30			.10			.0
Wall	.70	.50	.30	.10	.70	.50	.30	.10	.50	.30	.10	.50	.30	.10	.50	.30	.10	.00
0	.67	.67	.67	.67	.66	.66	.66	.66	.63	.63	.63	.60	.60	.60	.58	.58	.58	.57
1	.63	.61	.59	.58	.62	.60	.58	.57	.58	.56	.55	.56	.54	.53	.54	.53	.52	.51
2	.59	.55	.52	.50	.58	.54	.52	.49	.52	.50	.48	.51	.49	.47	.49	.47	.46	.45
3	.55	.50	.46	.43	.53	.49	.46	.43	.48	.45	.42	.46	.44	.42	.45	.43	.41	.40
4	.51	.45	.41	.38	.49	.44	.40	.37	.43	.40	.37	.42	.39	.37	.41	.38	.36	.35
5	.47	.40	.36	.33	.46	.40	.36	.33	.39	.35	.32	.38	.34	.32	.37	.34	.32	.31
6	.43	.36	.32	.29	.42	.36	.32	.29	.35	.31	.28	.34	.31	.28	.33	.30	.28	.27
7	.40	.33	.28	.25	.39	.32	.28	.25	.32	.28	.25	.31	.27	.25	.30	.27	.25	.24
8	.37	.29	.25	.22	.36	.29	.25	.22	.28	.24	.22	.28	.24	.22	.27	.24	.21	.20
9	.34	.26	.22	.19	.33	.26	.22	.19	.25	.22	.19	.25	.21	.19	.24	.21	.19	.18
10	.31	.24	.20	.17	.31	.24	.20	.17	.23	.19	.17	.23	.19	.17	.22	.19	.17	.18

A.L.P.-LAPLDA2209LCA

TESTING CONDUCTED BY:

Building Acoustics and  
Lighting Laboratories, Inc.

DATE: 3/30/98


REPORT NUMBER: 9804.0

20

Lumen Summary

Zone	Lumens	% Lamp	% Ft.²
0-30	1105	19.7	34.8
0-40	1760	31.4	55.4
0-60	2943	52.6	92.7
0-90	3174	56.7	100.0
90-120	0	0.0	0.0
90-130	0	0.0	0.0
90-150	0	0.0	0.0
90-180	0	0.0	0.0
0-180	3174	56.7	100.0

Zonal Lumen Summary

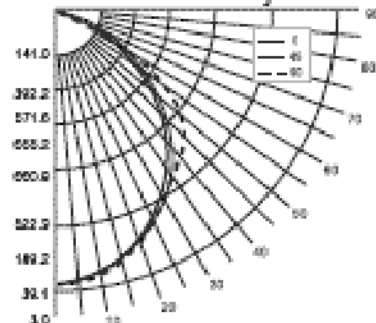

IES Spacing Criteria

End = 1.2	Diagonal = 1.1	Cross = 1.2
-----------	----------------	-------------

Ordering Information:

SCI FORM 0028

SERIES	PROFILE	LENGTH	LAMPS	BALLAST	OPTIONS
STD	RT2				